


## FIRE, THERMAL & ACOUSTIC PERFORMANCE

## **1** Decorative Timber Flooring

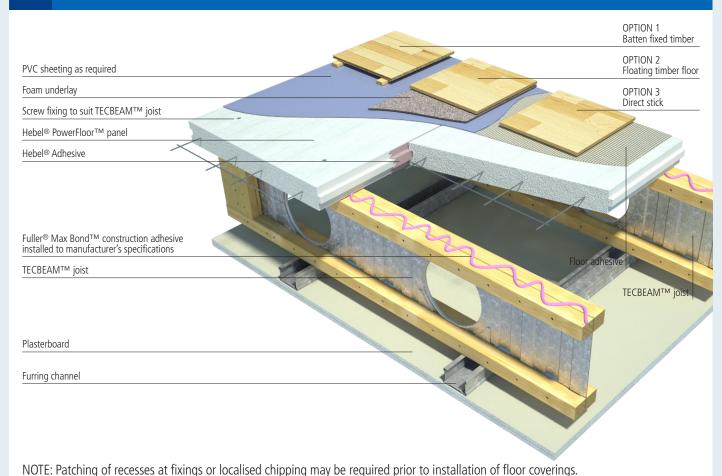

Fire Resistance <sup>①</sup>	Floor System Description	ACOUSTIC			THERMAL	
		R <sub>w</sub>	R <sub>w</sub> + C <sub>tr</sub>	L <sub>nw</sub> + C <sub>I</sub>	R-Value <sup>®</sup>	
					Up	Down
240/240/240 Opinion FCO 1303	<ul> <li>Batten fixed T&amp;G timber (PVC sheet as required)</li> <li>Hebel PowerFloor panel</li> <li>Tecbeam joists at 600mm max. centres</li> <li>No ceiling system</li> <li>T&amp;G Flooring and non-reflective 35mm air space</li> </ul>	37®	33 <sup>⊕</sup>	83 <sup>®</sup>	1.01	1.15
FRL <sup>®</sup>	Ceiling System Description	$R_{\rm w}$	$R_w + C_{tr}$	$L_{nw} + C_{l}$	R-Value <sup>®</sup>	
//	a) CSR821 with Bradford R1.5 Glasswool Batts	55 <sup>⑦</sup>	48 <sup>⑦</sup>	66 <sup>⑦</sup>	2.66	3.03
60/60/60	b) CSR826 with Bradford R2.0 Glasswool Batts	56 <sup>⑦</sup>	48 <sup>⑦</sup>	66 <sup>⑦</sup>	3.17	3.57
90/90/90	c) CSR827 with Bradford R1.5 Glasswool Batts	58 <sup>®</sup>	50 <sup>®</sup>	63 <sup>⑦</sup>	2.75	3.13

NOTE: \*Fire source from above only. Fire from above only - Opinion FCO 1303 Fire from below only - Opinion FCO 1373. (Refer to CSR Gyprock) Combined floor and ceiling system thermal

values are opinions determined for internal

conditions above and internal conditions below. Airflow direction -  $\mbox{Up} = \mbox{Summer}$ ,  $\mbox{Down} = \mbox{Winter}$ 

Acoustic Test CSIRO - TL413 - airborne sound transmission

Acoustic Test CSIRO - TLi413 - impact sound

transmission

Acoustic Assessment PKA - 210 091 A071 Thermal calculation by James Fricker 107.23 to 107.29 August 2011. Thermal calculations for second floor have assumed 140mm deep joist sections. For detailed information on ceiling systems, please refer to 'System Components' Section of this design guide and the CSR Gyprock Fibre Cement Fire & Acoustic Design Guide (The Red Book<sup>TM</sup>). For detailed information on acoustic testing, please contact CSR Hebel.